


Costing Run - 1-Selection

STEP 1

The date of the first day of the cycle appears. To avoid any problems, calculation must remain until 31.12.9999.

The cycle starts with the selection of the materials that are costed. Click on  in the column « Parameter » / line « Selection »

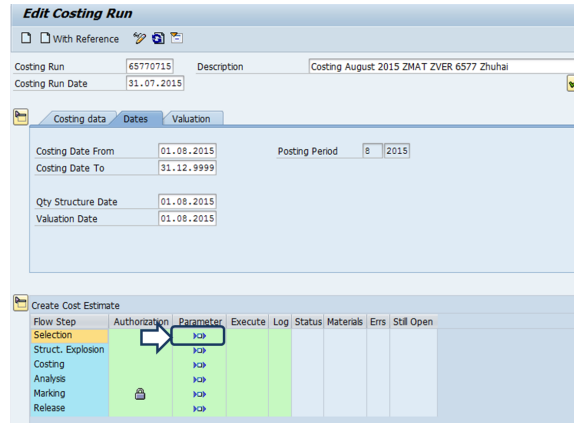


STEP 2

A new screen appears

1. Click on  beside Material Type
2. Enter the Material type :
 - **ZMAT** : Finished product & RM & SF
 - **ZVER** : Packaging


and execute 

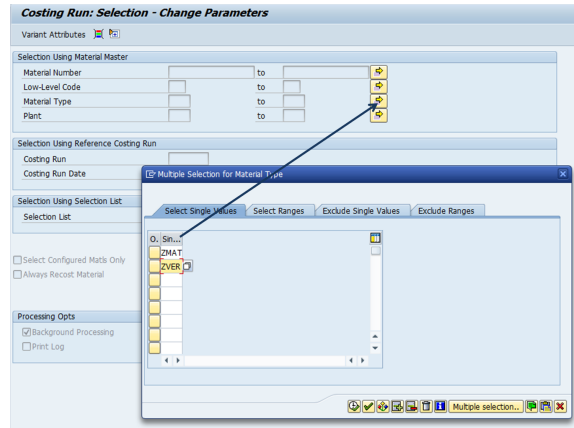

STEP 3

In the same screen update the plants:

1. Click on  beside Plant
2. In tab Exclude single values
3. Add the plants from **SQ00** in tab excludes

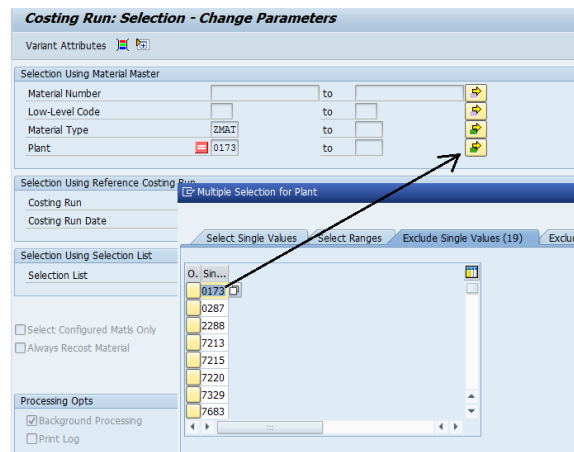


STEP 4


To remove Trading Plants (Négoce /NDIR) from WP1 Costing Run the following selections must be performed:

1. Go to **SQ00**, user group "**Costing**", choose the Query "**PLAN TS**" and execute 
2. In case you get an error message saying that your User is not assigned to any User Group, go to Environment -> Work areas and choose Standard area. After go to Edit -> Other User Group -> Costing.
3. Select Layout **/PLNT_CHECK** and confirm for your scope if Plants listed are excluded from **CK40N** parameters.

Conclusion: The Plants should be included/added to the already existing exclude list in CK40N (do not delete the Plants already in the List).

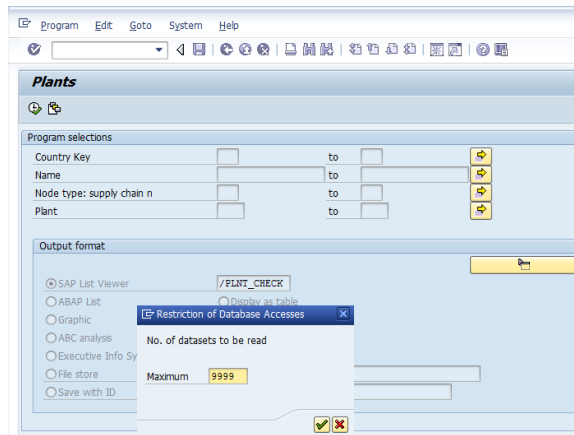

2



3

Plants						
Plnt	Name 1	Rg	Region (State, Provi	Cty	Nty	House number and street
7379	ZFR3 / Négoce BE			BE		
7330	ZFR3 / Négoce DE			DE	DC	
8107	ZFR3 / Négoce ES			ES		
7329	ZFR3 / Négoce FR	93	SEINE-ST-DENIS	FR	DC	
7360	ZFR3 / Négoce GB			GB	DC	
7390	ZFR3 / Négoce Hors UE			Q1	DC	
7353	ZFR3 / Négoce IT	MI	MILANO	IT	DC	VIA MILANO 78/80
7331	ZFR3 / Négoce NL			NL	DC	
7380	ZFR3 / Négoce UE			EU	DC	

STEP 5

Check Background Processing

and save

? Unknown Attachment

The message "Values of variant xxxx" appears

Go back by clicking



Costing Run: Selection - Change Parameters

Variant Attributes

Selection Using Material Master

Material Number: [] to []

Low-Level Code: [] to []

Material Type: ZMAT to []

Plant: [] to []

Selection Using Reference Costing Run

Costing Run: []

Costing Run Date: []

Selection Using Selection List

Selection List: []

☐ Select Configured Mats Only

☐ Always Recost Material

Processing Opts

☒ Background Processing

☐ Print Log

Values of variant 65770715735811 saved

STEP 6

1. Click on in the column « Execute » / line « Selection »
2. Check Start Immediately
3. Click on

? Unknown Attachment

Edit Costing Run

☐ With Reference

Costing Run: 65770715 Description: Costing August 2015 ZMAT ZVER 6577 Zhuhai

Costing Run Date: 31.07.2015

Costing data Dates Valuation

Costing Variant: ZFO PC Costing Variant RCS

Costing Version: 1 Version w/o Customizing

Controlling Area: 2024 Rhoda Asia Pacific

Company Code: 6577 Zhuhai Solway Sea Chem Co

Transfer Control: []

Server Group: []

Job name: 65770715_20150731_COST1200_01200

Server Group: []

Date/time AfterJob After event With oper. mode Workday/time

Planned Start: []

No Start After: []

☒ Start Immediately

Restriction Date/Time: []

☐ Change print param.

Check Confirm

Create Cost Estimates

Flow Step	Authorization	Parameter	Execute	Log
Selection				
Struct. Explosion				
Costing				
Analysis				
Marking				
Release				