

Technical Documentation - EHS SVT Report

- 1 [Access Management](#)
- 2 [DataFlow](#)
 - 2.1 [Overview](#)
 - 2.2 [Technical Rules on Workbench](#)
 - 2.2.1 [Scenario Determination \(C_SCEN\)](#)
 - 2.2.2 [Unit conversions](#)
 - 2.2.3 [Bex variables & corresponding class \(old data flow\)](#)
 - 2.2.4 [Bex queries used for data loading](#)
 - 2.2.5 [Japan & Korean usages \(C_USAGEJP\) - Old dataflow only](#)
 - 2.2.6 [SVT - Flow Data Consolidated with EHS data: ABEHSV04 & ABEHSV02](#)
 - 2.2.7 [Registered Volumes, Tonnage Bands, TSCA Section](#)
 - 2.2.8.1 [Algorithm in place for North America \(DSO DBEHS012/DBEHS011\)](#)
 - 2.2.8.2 [Algorithm in place for Europe : \(DSO DBEHS010 / DBEHS009 \)](#)
 - 2.2.8.3 [Algorithm in place for Asia : \(DSO DSO_EHSU / DBEHS006\)](#)
 - 2.2.8.4 [Report by report, which object is used?](#)
 - 2.2.8.5 [Object by objects, in with reports are they used?](#)
 - 2.2.8.6 [MasterData Threshold Limit \(C_THRHL\) & Attributs and descriptions](#)
 - 2.2.8.7 [Tonnage band alert \(ABEHSV07, CPEHSV08\)](#)
 - 2.2.8.8 [PO2 authorization scope:](#)
 - 2.2.9 [ABAP programs & functions](#)
 - 2.2.9.1 [ZBW_EHS001 - EHS - SVT - Selective Deletion on DPEHS006 Based on year](#)
 - 2.2.9.2 [ZBW_EHS002 EHS-SVT Determination of time intervals for loadings](#)
 - 2.2.9.3 [ZBW_EHS003 - EHS - SVT - Selective Deletion on DPEHS008 and DSO_EHS5 about compositions data based on current year](#)
 - 2.2.9.4 [ZBW_EHS001_GET_COMPOSITION - Get Composition Data](#)
 - 2.3 [Reporting](#)
 - 2.4 [Main queries \(old dataflow\)](#)
 - 2.5 [Main queries \(Generic dataflow\)](#)
 - 2.6 [Broadcast](#)
 - 2.6.1 [Availables broadcast](#)
 - 2.6.2 [US Broadcast rules](#)
 - 2.6.3 [Broadcast solution](#)
 - 2.6.4 [Queries used for broadcast](#)
 - 2.6.5 [Detail of US Broadcast email](#)
 - 2.6.6 [Other info for futur broadcast](#)
 - 2.6.7 [Broadcast tonnage band alert \(ABEHSV07, CPEHSV08\)](#)
 - 2.7 [Dependencies with other applications](#)
- 3 [Data Loading](#)
 - 3.1 [Info Providers and objects loaded](#)
 - 3.1.1 [Other Chains](#)
 - 3.2 [Data Loading](#)
- 4 [Data Quality Control](#)
- 5 [Operational Documentation](#)
 - 5.1 [Procedures](#)
 - 5.2 [Scheduling](#)
 - 5.3 [Monitoring](#)
 - 5.4 [Error Handling](#)
 - 5.5 [Known Bugs](#)
 - 5.6 [Roadmap](#)

Access Management

Roles & Access

Role Code	Role Description	Explanation
ZR_RC S_EHS _A07	EHS – Substance Volume Tracking Application - End User Role	Role menu / Based on authorization object ZBI_SVT Caution: ZBI_SVT gives access to all C_PLANT including BUTA (CC ZFR9). As the roles were not ready it has been decided not to load Buta data in REACH cube (SVT Analysis - EU (Rhodia) / CREHS06) => the company code ZFR9 is filtered in both DTP. See below important information
ZR_RC S_CA_ M48	EHS – Substance Volume Tracking	Role menu which gives access to all workbooks.
ZBI_JP _EHS_ P06	EHS – Substance Volume Tracking Japan	Role perimeter / Based on authorization object ZJPEHSP06 / Country JP
ZBI_K R_EHS_ _P06	EHS – Substance Volume Tracking Korean	Role perimeter / Based on authorization object ZKREHSP06 / Country KR
ZBI_C N_EHS_ _P06	EHS – Substance Volume Tracking China	Role perimeter / Based on authorization object ZCNEHSP06 / Country CN
ZBI_TR _EHS_ P06	EHS – Substance Volume Tracking Turkish	Role perimeter / Based on authorization object ZTREHSP06 / Country TR
ZBI_T OUT_E HS_P06	EHS – Substance Volume Tracking ALL PERIMETER	Role perimeter / Based on authorization object ZALLEHSP06 / all countries
ZBI_E U_EHS_ _P06	EHS – Substance Volume Tracking Europe	Role perimeter / Based on authorization object ZEUEHSP06 / Country of the REACH area FR, BE, DE...
ZBI_U S_EHS_ _P06	EHS – Substance Volume Tracking USA	Role perimeter / Based on authorization object ZUSEHSP06 / Gives access to country US Associated country and islands PR, GU, VI, AS, MP should also be part of the perimeter role. Currently it is not the case.
ZBI_C A_EHS_ _P06	EHS – Substance Volume Tracking Canada	Role perimeter / Based on authorization object ZCAEHSP06 / Country CA

Generic dataflow:

Role Code	Role Description
ZBI_RCS_EHS_A03	Environment, Health and Safety Analysis - Key User Role
ZP2_RCS_EHS_A02	Environment, Health and Safety Analysis - End User Role
ZR_RCS_EHS_A00	Environment, Health and Safety Analysis - RCS/APM role
ZR_RCS_EHS_A01	Environment, Health and Safety Analysis - Super User Role
ZR_RCS_EHS_A02	Environment, Health and Safety Analysis - End User Role
ZR_RCS_EHS_A03	Environment, Health and Safety Analysis - Key User Role

Usefull to know:

1- Menu Roles ZR_RCS_CA_M40 "EHS – Substance Volume Tracking Asia" and ZR_RCS_CA_M36 "EHS – Substance Volume Tracking North America" **are now obsolete**.

There are replaced by ZR_RCS_CA_M48.

2- Perimeter roles ZBI_RCS_EHS_P06 to ZBI_RCS_EHS_P12 are obsolete because Authorization Team has decided to use naming ZBI_xx_EHS_P06 (xx = country)

3- Perimeter roles ZR_RCS_EHS_P06 to P09 and P11, P13 to P15 are obsolete because old naming.

Usefull to know concerning BUTA Chimie (Company Code ZFR9) :

A filter on C_PLANT from authorization has been added in all SVT queries :

- variable V_AUT_C_PLANT_0001 for EU report as the Plant is a selection criteria
- variable V_C_PLANT_0001 for all other as the Plant is not a selection criteria

The C_PLANT will have to be removed in object ZBI_SVT (A pplication Role ZR_RCS_EHS_A07)

Following perimeter role will have to be managed for all EHS SVT users :

- For all plants, except BUTA, use perimeter role ZR_TOUT_CA_P02 / object ZTOUTCAP02
- For BUTA plants, use perimeter role ZR_7866_CA_P02 / object Z7866CAP02

The BUTA data will have to be loaded in cube REACH (SVT Analysis - EU (Rhodia) / CREHS06).

Usefull current authorization matrix

See also file maintained by Authorization team : BW Catalog of Roles / link: https://drive.google.com/open?id=10GEfKYqrT1eeTO_uHYAheL1GX7L5y_pvH0KQU64qh5l

Authorization Objects

List of authorization objects mandatory for the application.

Authorization object	Explanation
Country of Origin (C_CNTRY_O)	old dataflow ZBI_*_EHS_P06
Plant (C_PLANT)	See above explanation for role ZR_RCS_EHS_A07 ZR_*_CA_P02
0EHS_AUTH 0EHS_SPEC__0EHS_AUTH	Authorization group role: ZR_*_CA_P30
C_AUTHMA	Authorization scope role: ZR_*_CA_P00


Link to the BW Catalog of role

https://drive.google.com/open?id=10GEfKYqrT1eeTO_uHYAheL1GX7L5y_pvH0KQU64qh5l

DataFlow

Overview

Old Dataflow:

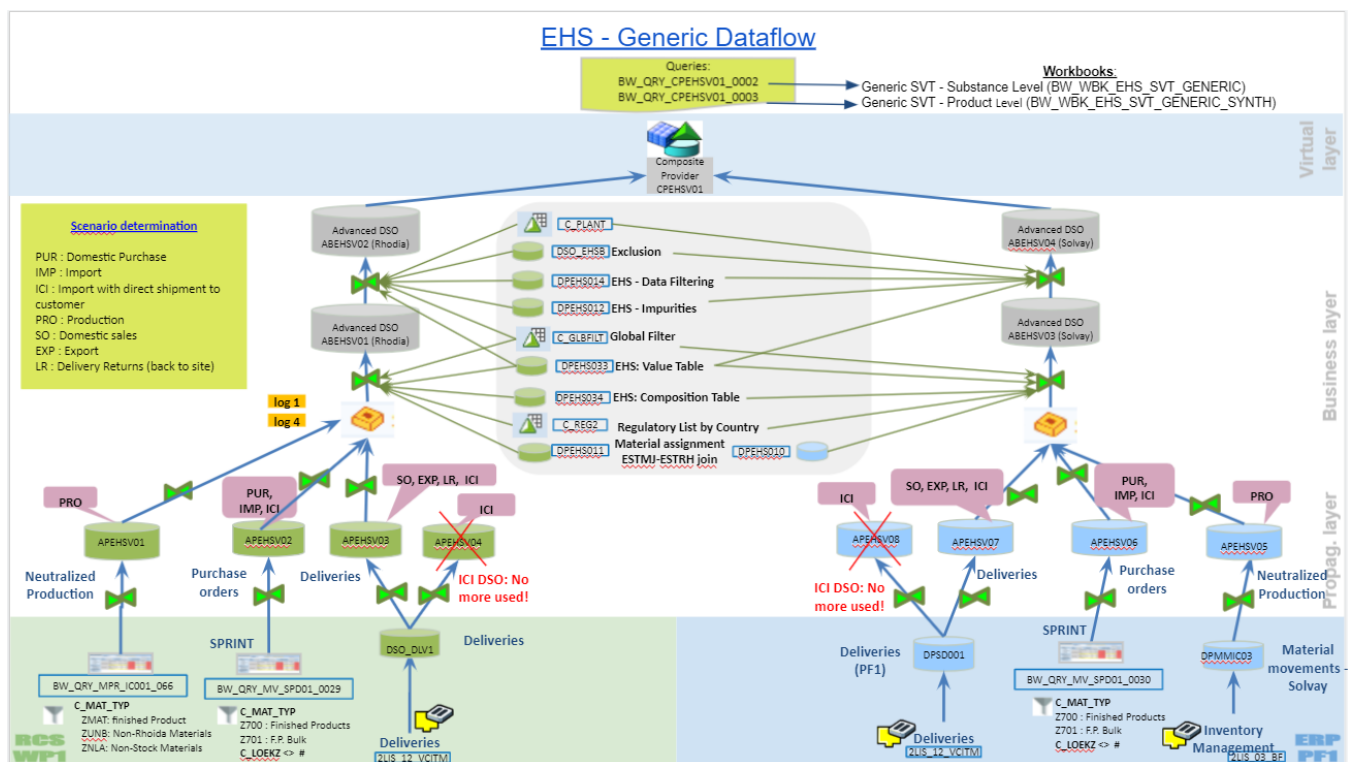

Reporting documentation drive folder:

<https://drive.google.com/drive/folders/0B0qn89R0RGdYkZZOFZyYXIXVke>

Example of dataflow overview :

Template Application name DataFlow

Technical Rules on Workbench

Technical specifications

The dataflow is in the following document : EHS-SVT-Documentation:

Scenario Determination (C_SCEN)

In transformation TRCS IFS_EHS_SVT_RO2 -> ADSO ABEHSV01:

C_SCEN is defined in end routine in function of several rules, the results could be:

When source = APEHSV01 (Neutralized Production (WP1)) PRO

When source = APEHSV03 (Deliveries (WP1)) LR, SO, EXP or ICI

When source = APEHSV02 (Direct Shipment (WP1)) PUR, IMP or ICI.


In transformation TRCS IFS_EHS_SVT_RO3 -> ADSO ABEHSV03:

C_SCEN is defined in end routine in function of several rules, the results could be:

APEHSV05 (Neutralized Production (PF1)) PRO

APEHSV06 (Purchasing data (PF1)) PUR, IMP or ICI

APEHSV07 (Deliveries (PF1)) LR, SO, EXP or ICI

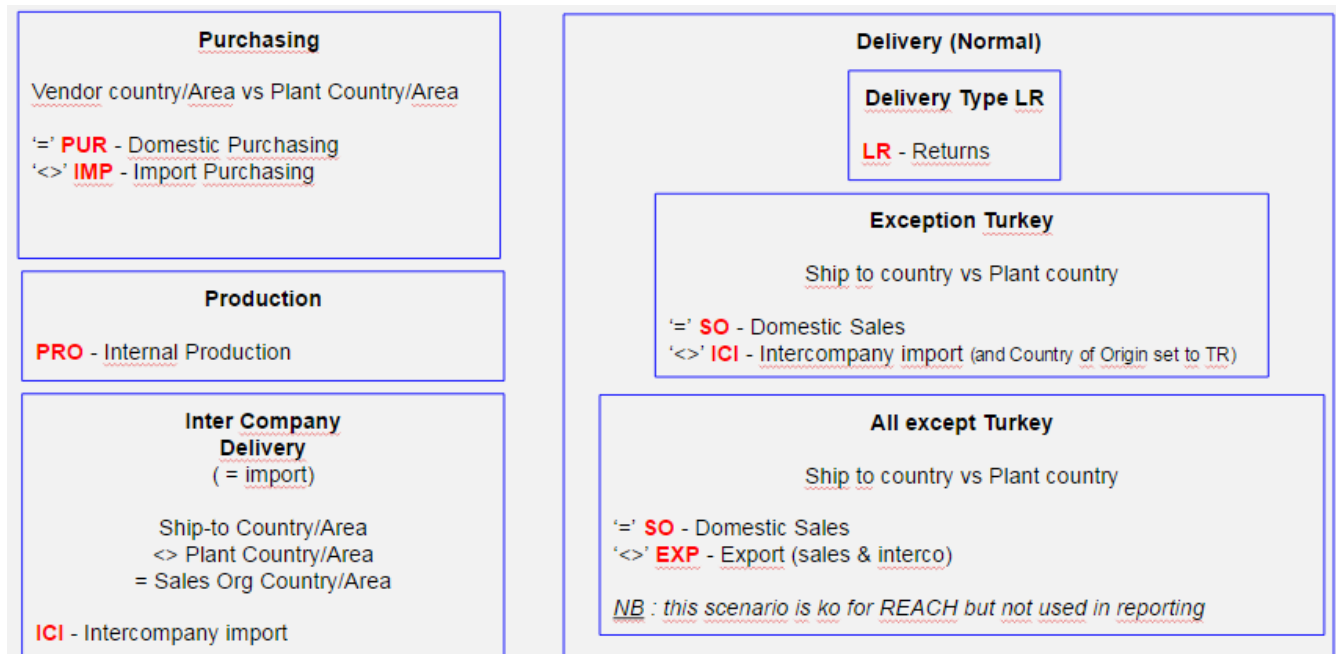

Unit conversions

The Unit conversion is done in the Bex queries (Quantity Conversion Type), depending on reports

- Reporting in pound (LB) for US
- Reporting in kilogram (KG) for Canada
- Reporting in Ton (TO) for all others

Transactionnal data are stored in material base unit, except of SPRINT Reception quantities (PO Unit)

- if base unit / po unit is managed in dimension MASS, conversion within table T006 works well
- if base unit / po unit is not managed in dimension MASS, conversions for KG/LB/TO have to be managed on ERP side (MM03 / Alternative Conversion).

Example : production done on unit KRE; other used units 1KG, M2, M3, KN3...

There are many "special" units on Solvay ERP.

Important :

Quantities are not converted when loading data, and are not store into cubes (The conversion is done when running the report)

So, if a conversion is missing for a material ask the material referent to

- 1- manage the conversion on ERP Side by managed the material master (MM03) / unit of measure tab
- 2- the day after, when the DSO UOMCMAT2 is filled, the conversion is applied in the reports. It applies to whole data without any reloading.

Bex variables & corresponding class (old data flow)

Following variables are used in the Bex Queries used to extract data for SVT and also in DTP for weekly loading.

See ABAP Code in Classe (SE24) / Table for BADI / Variable link = ZBIU001_V_VAR

- BEFORE_VARIABLE_SCREEN method has been filled to BEx Queries (Souce of data)
- AUTHORITY_CHECK method has been filled to use variable in DTP selection

Variable Name	Variable Description	Related classe name	object
V_0CALMONTH_001	Get period (Current or current+previous) for Japan from c_glbflt in variable V_0CALMONTH_0001	ZCL_BIU001_V_0CALMONTH_0001	0CALMONTH

V_0CALMONTH_0002	Get period (Current or current+previous) for Other cntry from c_glbfilt in variable V_0CALMONTH_0002	ZCL_BIU001_V_0CALMONTH_0002	0CALMONTH
V_0CALMONTH_0003	Get period current period for Japan from c_glbfilt in variable V_0CALMONTH_0003	ZCL_BIU001_V_0CALMONTH_0003	0CALMONTH
V_0CALMONTH_0004	Get previous period for Japan from c_glbfilt in variable V_0CALMONTH_0004	ZCL_BIU001_V_0CALMONTH_0004	0CALMONTH
V_0CALMONTH_0005	Get current period for Other country from c_glbfilt in variable V_0CALMONTH_0005	ZCL_BIU001_V_0CALMONTH_0005	0CALMONTH
V_0CALMONTH_0006	Get previous period for other country from c_glbfilt in variable V_0CALMONTH_0006	ZCL_BIU001_V_0CALMONTH_0006	0CALMONTH
V_0CALMONTH_0046	Get period from global filter c_glbfilt stream EHS_SVT rule DATA_LOAD in variable V_0CALMONTH_0046 in CURRENT mode: current year + 2 last years.	ZCL_BIU001_V_0CALMONTH_0046	0CALMONTH
V_0CALMONTH_0052	Get period from global filter c_glbfilt stream EHS_SVT rule DATA_LOAD in variable V_0CALMONTH_0052 in CURRENT mode: current and previous month	ZCL_BIU001_V_0CALMONTH_0052	0CALMONTH
V_0CALMONTH_0053	Get period from global filter c_glbfilt stream EHS_SVT rule DATA_LOAD in variable V_0CALMONTH_0053 in CURRENT mode: current year (from 01 to current month)	ZCL_BIU001_V_0CALMONTH_0053	0CALMONTH
V_C_CNTRY_O_0004	Get the list country related with REACH regulatory list from C_REG2 in variable V_C_CNTRY_O_0004	ZCL_BIU001_V_C_CNTRY_O_0004	C_CNTRY_O
V_0PLANT_0006	EHS - Get Japan plant list (Customer Exit)	ZCL_BIU001_V_0PLANT_0006	0PLANT
V_0PLANT_0007	EHS - Get other plant list (Customer Exit)	ZCL_BIU001_V_0PLANT_0007	0PLANT

Bex queries used for data loading

Bex queries have been created to extract data from existing BW applications. Theses queries are dedicated to EHS, and all requested filters are done in the queries (interval of month, list of plant, material type limitation...). Queries are slightly different from RCS or Solvay.

Also Japan is always by its own has the corresponding year is from April Y to Mars Y+1

The interval of time is get from the global filter C_GLBFLT (stream EHS / rule DATA*)

For purchasing data :

Rhodia	BW_QRY_MV_SPD01_0010	SPRINT - Rhodia Purchase Other Data For EHS	13/11 Exclusion PO Doc Type UB
Rhodia	BW_QRY_MV_SPD01_0012	SPRINT - Rhodia Purchase Japan Data For EHS	13/11 Exclusion PO Doc Type UB
Solvay	BW_QRY_MV_SPD01_0013	SPRINT - Solvay Purchase Japan Data For EHS	
Solvay	BW_QRY_MV_SPD01_0009	SPRINT - Solvay Purchase Other Data For EHS	

For production data :

Rhodia	BW_QRY_MPR_IC001_063	BW - EHS - Neutralized Production Other data for EHS	26/10 Ajout des material type ZUNB / ZNLA
Rhodia	BW_QRY_MPR_IC001_064	BW - EHS - Neutralized Production Japan data for EHS	26/10 Ajout des material type ZUNB / ZNLA

On Generic dataflow , the DSO concerned by those Bex Queries as source of loading are;

- DSO APEHSV01 (Neutralized Production (WP1)) : loaded by query BW_QRY_MPR_IC001_066 (BW - EHS - Neutralized Production data for EHS (Hana Flow))
- DSO APEHSV02 (Purchasing data (WP1)) : loaded by query BW_QRY_MV_SPD01_0029 (SPRINT - Rhodia Purchase Data For EHS (Hana Flow))
- DSO APEHSV06 (Purchasing data (PF1)) : loaded by query BW_QRY_MV_SPD01_0030 (SPRINT - Solvay Purchase Data For EHS (Hana Flow))


For manual loadings, outside of current loading: be careful with large extraction on those loadings, job can use a lot of memories on the system and generate locks and dumps.

It is better to launch those loadings after or before closing periods. If not possible to wait, load on a few month time perimeter only, and not a long period.

With short time execution, loadings are OK and there is no issues.

Japan & Korean usages (C_USAGEJP) - Old dataflow only

Technical rule to avoid loading to many usage in MasterData C_USAGEJP

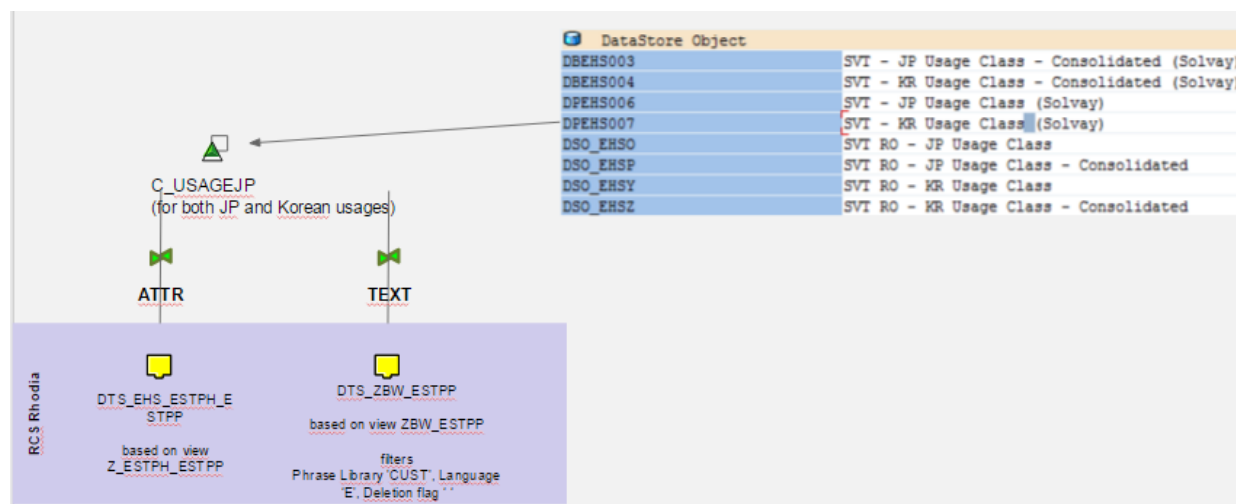

-> New usages are created into MasterData C_USAGEJP when these DSO are filled

Example : CUST-RH01.99000027

-> Attributes and Texts are only loaded if the usage exists in the Masterdata

Caution :

- the text transfo + DTP was created in WBP directly in 01.2014
- the C_USAGEJP Attr is loaded with masterdata but it need to be loaded after DSO (=> better to change PCH, attributes are loading the following week)
- the C_USAGEJP Text is not automatic (=> better to be added in PCH)


Steps for to reload historical for a year :

- delete values for year to reload in DSOs manually. Do not use the Abap program which is based on others Global Filters variables
- change Global Filter C_GLBFLT with year to reload
- load DSOs
- change Global Filter C_GLBFLT to set historical load inactive
- Load masterdata C_USAGEJP attributes & texts

SVT - Flow Data Consolidated with EHS data: ABEHSV04 & ABEHSV02

Fields "C_RP*" (Registration Perimeter) are filled in end routine with a lookup on dso DBEHS026 with help of DPEHS033. See start and end routine to have more details.

Registered Volumes, Tonnage Bands, TSCA Section

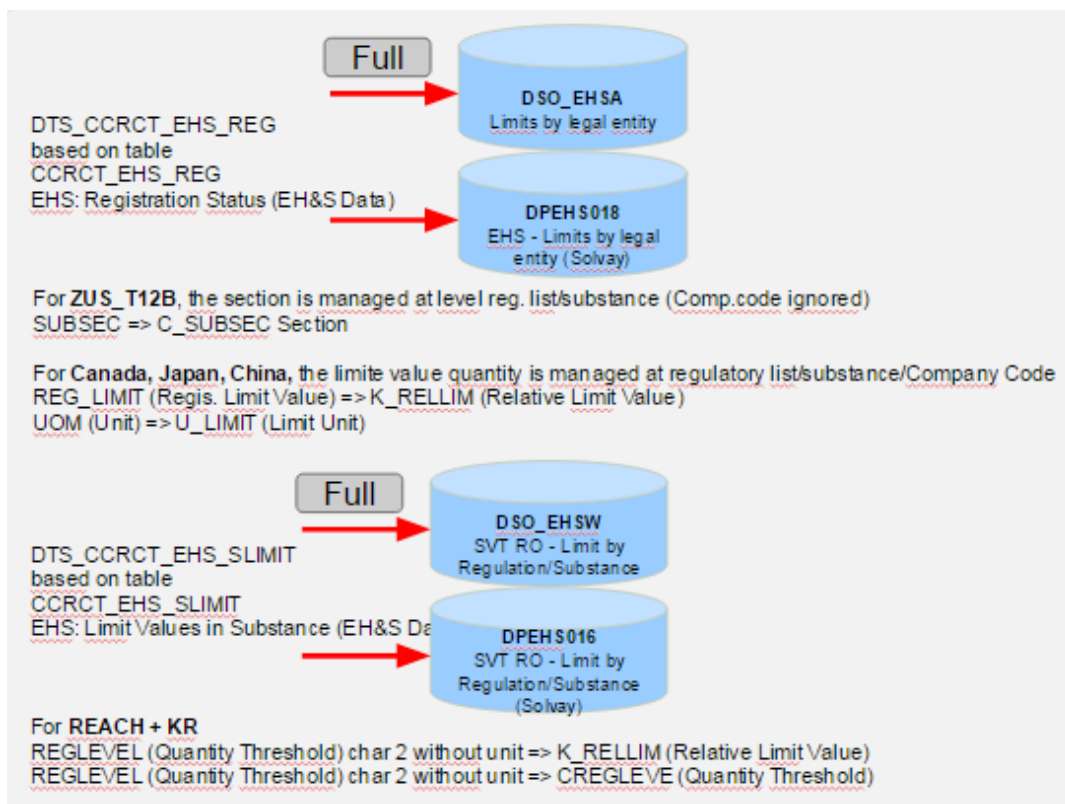

Algorithm in place for North America (DSO DBEHS012/DBEHS011)

Step1 = search in EHSA with Reg/Substance (one access only)

- > flow year have to be into validity interval
- > store k_rellim into k_limqty (with unit / conversion possible) + u_limit into u_limit
- > store c_subsec into c_subsec

Set 2 = search in EHSW with Reg/Substance

For all record with same Reg/Substance/Company Code

- > flow year have to be into validity interval
- > if 1st record store cregleve into c_thrld
- > if 2nd or more and if cregleve > than previous cregleve, store new cregleve into c_thrld

If c_thrld is not initial and c_thrld exist in masterdata :

- > store master data k_upqty to k_limqty + u_limit into u_limit

Step 2 possible pour North America ?

Algorithm in place for Europe : (DSO DBEHS010 / DBEHS009)

Search in EHSW with Reg/Substance/Company Code

For all record with same Reg/Substance/Company Code

- > flow year have to be into validity interval
- > if 1st record store cregleve into c_thrld
- > if 2nd or more and if cregleve > than previous cregleve, store new cregleve into c_thrld

If c_thrld is not initial and c_thrld exist in masterdata :

- > store master data k_upqty to k_limqty + u_limit into u_limit

Algorithm in place for Asia : (DSO DSO_EHSU / DBEHS006)

-> Case regulatory ZCN_NEW_CH or 'ZJP_ISHL' or 'ZJP_CSCL'

search in EHSA with Reg/Substance (one access only)
store k_rellim into k_rellim (Relative Limit Value / no unit)
store c_regstat into c_regstat (Regulation/Notification Status)
-> Case regulatory ZTR_CICR
store 1 into k_rellim (Relative Limit Value / no unit)
search in EHSA with Reg/Substance (one access only)
store c_regstat into c_regstat (Regulation/Notification Status)
store c_rstat into c_rstat (Registration Status)
-> Case regulatory 'ZKR_NEW' or 'ZKR_DESIGN'

Search in EHSW with Reg/Substance
If k_rellim exists in masterdata c_thrld-> store master data k_uppqty to k_rellim + c_thrld

Report by report, which object is used?

- Reports for Japan => K_rellim is used (EHS_REG)
- Reports for Korea => C_thrld is used (EHS_SLIMIT)
- Reports for China => none used
- Report for Turkey => C_thrld is used but not filled for TR. Should we take the k_rellim ?
- Report for Europe => C_thrld is used (EHS_SLIMIT)
- Report for US => none used
- Report for Canada => Report non DSL => C_thrld is used => but shouldn't we take the k_limqty converted in KG (EHS_REG) ?

Object by objects, in with reports are they used?

- C_THRHLD Threshold Limit = Tonnage band (with text) from EHS_SLIMIT

=> For REACH + KOREA + NA (but real case?)

- K_LIMQTY Limit Quantity (with unit) from EHS_REG or upper value of Tonnage band

=> for Canada, REACH,

- K_RELLIM Relative Limit Value (without unit) from EHS_REG / Constant / EHS_SLIMIT

=> for ASIA and TR

MasterData Threshold Limit (C_THRHLD) & Attributs and descriptions

Attributs were loaded from a flat file (by Jonathan in mai 2014)

Text were filled manually for Asia, and Reach.


Tonnage band alert (ABEHSV07, CPEHSV08)

PO2 authorization scope:

For Power Of Two project, the scope by authorization group was recovered from table ZWEHST103 in WP1 system.

In master data 0EHS_AUTH (Authorization group) two attributes are added: CPFCTR1_2 (GBU) and C_AUTHMA (Scope).

Then in the transformation linked to 0EHS_SPEC a lookup is done with 0EHS_AUTH to take the GBU and C_AUTHMA associated (loading done in process chain "EHS_MASTER_DATA"):

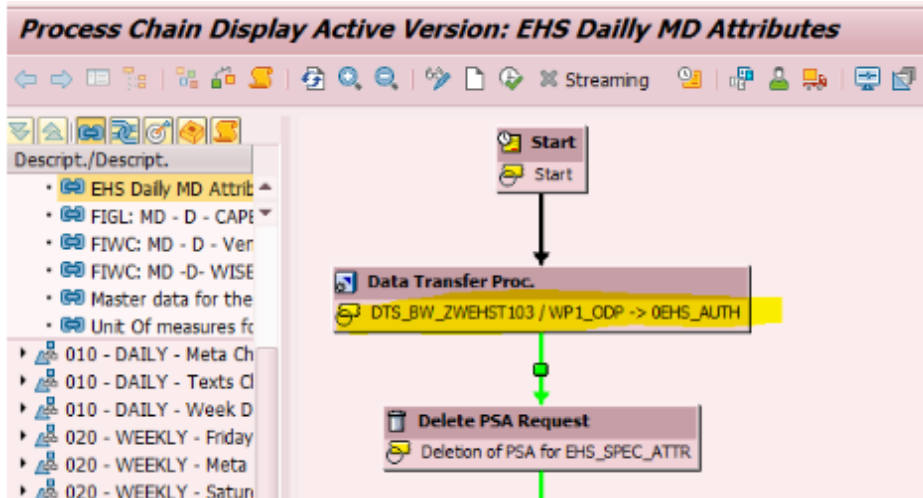

Then in EHS queries, we can use the C_AUTHMA to segregate at authorization level between ECO and SCO data.

ABAP programs & functions

ZBW_EHS001 - EHS - SVT - Selective Deletion on DPEHS006 Based on year

This program deletes data on DSOs and ADSO identified (not necessarily on DPEHS006 - program's text should be changed) in the selection criterium.

It deletes data regarding the variables values in the Global Filter (C_GLBFLT) for Stream EHS, and Rule DATA* for old dataflow, or for new dataflow Stream EHS_SVT Rule DATA_LOAD.

Data Browser: Table /BIC/PC_GLBFLT Select Entries11

This program is used in the main process chain with following variants

Variant name	Short Description
GEN_RHODIA	Deletion for Rhodia (Gen Flow)
GEN_RHODIA_BUS	Deletion Rhodia Business (Gen)
GEN_RHODIA_PRP	Deletion Rhodia Propa (Gen)
GEN_SOLVAY	Deletion for Solvay (Gen Flow)
GEN_SOLVAY_BUS	Deletion Solvay Business (Gen)
GEN_SOLVAY_PRP	Deletion Solvay Propa (Gen)
RHODIA_AU	Deletion for Japan (Rhodia)
RHODIA_JP	Deletion for Japan (Rhodia)
RHODIA_OTHERS	Deletion for Others (Rhodia)
RHODIA_US	Deletion for US (Rhodia)

SOLVAY_JP	Deletion for Solvay (Solvay)
SOLVAY_OTHERS	Deletion for Others (Solvay)
SOLVAY_US	Deletion for US (Solvay)

At execution, on selection screen, we choose data to delete: Japan, Australia or other.

EHS - SVT - Selective Deletion on SVT DSO Based on Period (0CALMONTH)

DSO Name input for selective Deletion

Datastore Object

☐ Case Japan
☒ Case Other
☐ Case Australia
☐ Generic Dataflow ?
☐ Historical data ?
☐ TSCA Dataflow ?
☐ ADSO Propa ?
☐ Display Application Log

If it concerns new dataflow, "Generic Dataflow ?" should be selected.

If it concerns TSCA dataflow, used in a specific process chains (PC_EHS_SVT_GENFLW_TSCA, PC_EHS_SVT_OLD_FLW_TSCA), "TSCA dataflow" must be selected.

If it concerns ADSO of propagation layer, "ADSO Propa" must be selected.

ZBW_EHS002 EHS-SVT Determination of time intervals for loadings

This program updates variables in the Global Filter (C_GLBFLT) for Stream EHS, and Rule DATA*

The intervals of months are determined using the current date (SY-DATUM).

Loading for all Countries (Exercise January to December)

☒ Load Current Exercise
☒ Load Previous Exercise ONLY between the and of January

Special loading for JAPAN (Exercise April to March)

☒ Load Current Exercise
☒ Load Previous Exercise ONLY between the and of April


Case of Initialization/History reload

☐ Do not update MD Global Filter

Notice that if variable exist in C_GLBFLT but is not checked in the program, the variable will be updated to inactive (attribute C_ACTIVE changed to 'N').

Caution : if the option 'Do not update MD Global Filter' is set, values will have to be modified manually in the masterdata when changing year

This program is used in the main process chain with following variants

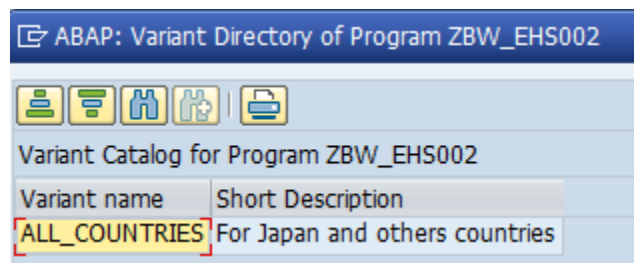

The screenshot shows the 'ABAP: Variant Directory of Program ZBW_EHS002' window. It features a toolbar with icons for user management, list, navigation, and printing. Below the title bar, the text 'Variant Catalog for Program ZBW_EHS002' is displayed. A table with two columns, 'Variant name' and 'Short Description', is shown. The first row contains the variant 'ALL_COUNTRIES' (highlighted with a red box) and its description 'For Japan and others countries'.

Variant name	Short Description
ALL_COUNTRIES	For Japan and others countries


This program is not used on generic dataflow

ZBW_EHS003 - EHS - SVT - Selective Deletion on DPEHS008 and DSO_EHS5 about compositions data based on current year

This program deletes data in business DSOs identified in the selection criterium.

It deletes data regarding the current year based on actual date (sy-datum).

This program is used in the main process chain with following variants:

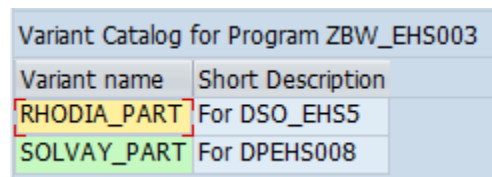

The screenshot shows the 'Variant Catalog for Program ZBW_EHS003' window. It displays a table with two columns: 'Variant name' and 'Short Description'. There are two rows: 'RHODIA_PART' (highlighted with a red box) with description 'For DSO_EHS5', and 'SOLVAY_PART' (highlighted with a green box) with description 'For DPEHS008'.

Variant name	Short Description
RHODIA_PART	For DSO_EHS5
SOLVAY_PART	For DPEHS008

This program is not used on generic dataflow

ZBW_EHS001_GET_COMPOSITION - Get Composition Data

This function is used in transformation loading DSO_EHSR (for RCS) and DBEHS005 (for Solvay) which are Flow data with compositions

It read the composition/regulatory list from DSOs DPEHS00800 (for Solvay) or DSO_EHS5 (for RCS)

Import parameters :

- Material (C_MATNR2)
- Calendar Year (CALYEAR)
- Country key (COUNTRY)
- Source System (LOGSYS)

This program is not used on generic dataflow

Reporting

Main queries (old dataflow)

For EHS SVT, queries have been developped, but for each query, an analysis workbook has been settled => only one access mode.

All queries/workbooks are published in an unique role menu " EHS – Substance Volume Tracking" (ZR_RCS_CA_M48)

EHS – Substance Volume Tracking				
🌐 Asia				
🇯🇵 Japan				
		JP Annual reporting of chemicals (Core Query)	QRY	BW_QRY_MPR_EHS07_JP_0001
		JP Annual Reporting (Core Workbook)	WB	BW_WBK_EHS_SVT_JP_001
		JP Annual reporting of SVE/LPN of new chemicals (Core Query)	QRY	BW_QRY_MPR_EHS07_JP_0002
		JP SVE-LPN Annual Reporting (Core Workbook)	WB	BW_WBK_EHS_SVT_JP_002
🇨🇳 China				
		CN Registered new chemicals (Core Query)	QRY	BW_QRY_MPR_EHS07_CN_0001
		CN Registered New Chemicals (Core Workbook)	WB	BW_WBK_EHS_SVT_CN_001
		CN Key environmental controlled haz. chemicals (Core Query)	QRY	BW_QRY_MPR_EHS07_CN_0002
		CN KECH Chemicals (Core Workbook)	WB	BW_WBK_EHS_SVT_CN_002
🇰🇷 Korea				
		KR Annual reporting of chemicals (Core Query)	QRY	BW_QRY_MPR_EHS07_KR_0001
		KR Annual Reporting (Core Workbook)	WB	BW_WBK_EHS_SVT_KR_001
		KR Registration (Core Query)	QRY	BW_QRY_MPR_EHS07_KR_0002
		KR Registration (Core Workbook)	WB	BW_WBK_EHS_SVT_KR_002
🇪🇺 REACH & Turkey				
		EU REACH (Core Query)	QRY	BW_QRY_MPR_EHS07_EU_0001
		EU REACH (Core Workbook)	WB	BW_WBK_EHS_SVT_EU_001
		TR Substances Notification (Core Query)	QRY	BW_QRY_MPR_EHS07_TR_0001
		TR Substances Notification (Core Workbook)	WB	BW_WBK_EHS_SVT_TR_001
🇺🇸 North America				
🇺🇸 US				
		US TSCA CDR (Core Query)	QRY	BW_QRY_MPR_EHS07_US_0001
		US TSCA CDR (Core Workbook)	WB	BW_WBK_EHS_SVT_US_001
		US TSCA 12b (Core Query)	QRY	BW_QRY_MPR_EHS07_US_0002
		US TSCA 12b (Core Workbook)	WB	BW_WBK_EHS_SVT_US_002
		EHS - Imported Material without Composition (Core query)	QRY	BW_QRY_MPR_EHS02_0005
		EHS - Imports List by Material (Core query)	QRY	BW_QRY_MPR_EHS02_0004
		EHS - Imports list from GTS (Core query)	QRY	BW_QRY_MPR_EHS02_0002
		EHS - Imports List by Substance (Core query)	QRY	BW_QRY_MPR_EHS02_0006
🇨🇦 Canada				
		Canada Non DSL Tracking (Core Query)	QRY	BW_QRY_MPR_EHS07_CA_0001
		Canada Non DSL Tracking (Core Workbook)	WB	BW_WBK_EHS_SVT_CA_001
		Extended tracking for Canada (Core Query)	QRY	BW_QRY_MPR_EHS07_CA_0002
		Extended tracking for Canada (Core Workbook)	WB	BW_WBK_EHS_SVT_CA_002

New Query: SVT Report-Notification of nanomaterials Europe (core query) => BW_QRY_MPR_EHS07_EU_0002

NB : Following queries are not yet available as workbook (not part of convergence project), a freshdesk has to be created by the Business Team.

- EHS - Imported Material without Composition (Core query) => BW_QRY_MPR_EHS02_0005
- EHS - Imports List by Material (Core query) => BW_QRY_MPR_EHS02_0004
- EHS - Imports list from GTS (Core query) => BW_QRY_MPR_EHS02_0002
- EHS - Imports List by Substance (Core query) => BW_QRY_MPR_EHS02_0006

All reports have following common filters

- Country of Origin (C_CNTRY_O) = autorisation
- Tracking Flag (C_TRCKFLG) = 'Y'
- Component Type Exclusion (C_IMPFLG) = 'N'
- Material Exclusion Flag (C_EXCLUSI) = 'N'
- Chemical reaction <> 0 'NO'

All reports have following condition

- Quantites PRO >= 0

Here are the different filters for each report

		Reg List (C_RE G)	Cube (0INFOPROV)	Scenario (C_SCEN)	Others
BW_WBK_EHS_SVT_GENERIC	BW_QRY_CPEHSV01_0002	All	ABEHSV02, ABE HSV04	All	
Generic SVT - Substance Level (Core Workbook)	EHS - SVT Generic reporting Query (Core)		(Composite Provider CPEHS V01:)		

BW_WBK_EHS_SVT_GENERIC Generic SVT - Product Level (Core Workbook)	BW_QRY_CPEHSV01_0003 EHS - SVT Generic reporting Synthesis Query (Core)	All	ABEHSV02, ABE HSV04 (Composite Provider CPEHS V01:)	All	
BW_WBK_EHS_SVT_CN_001 CN Registered New Chemicals (Core Workbook)	BW_QRY_MPR_EHS07_CN_0 001 CN Registered new chemicals (Core Query)	ZCN_NEW_ CH	CUB_EHS07, CREHS02	all except PUR	Regulation Code (C_REGCODE) / Type of substance = CN001 + '#'
BW_WBK_EHS_SVT_CN_002 CN KECH Chemicals (Core Workbook)	BW_QRY_MPR_EHS07_CN_0 002 CN Key environmental controlled haz. chemicals (Core Query)	ZCN_KECHC	CUB_EHS07, CREHS02	PRO	Regulation Code (C_REGCODE) / Type of subst. = CN002 + '#'
BW_WBK_EHS_SVT_JP_001 JP Annual Reporting (Core Workbook)	BW_QRY_MPR_EHS07_JP_00 01 JP Annual reporting of chemicals (Core Query)	ZJP_AN_REP	CREHS01, CUB_EHS06	All except PUR	Regulation Code (C_REGCODE) / Type of subst. = JP001, JP002, JP003, #
BW_WBK_EHS_SVT_JP_002 JP SVE-LPN Annual Reporting (Core Workbook)	BW_QRY_MPR_EHS07_JP_00 02 JP Annual reporting of SVE /LPN of new chemicals (Core Query)	ZJP_CSCL, ZJP_ISHL	CREHS01, CUB_EHS06	EXP, IMP, PRO, ICI	Regulation Code (C_REGCODE) / Type of subst. = JP004, JP005, JP006, #
BW_WBK_EHS_SVT_KR_001 KR Annual Reporting (Core Workbook)	BW_QRY_MPR_EHS07_KR_0 001 KR Annual reporting of chemicals (Core Query)	ZKR_AN_R EP	CREHS03, CUB_EHS08	all	Regulation Code (C_REGCODE) / Type of subst. = KR001, KR002, #
BW_WBK_EHS_SVT_KR_002 KR Registration (Core Workbook)	BW_QRY_MPR_EHS07_KR_0 002 KR Registration (Core Query)	ZKR_DESIG N, ZKR_NEW	CREHS03, CUB_EHS08	PRO/ICI/IMP On devrait ajouter le filtre dans qry	Regulation Code (C_REGCODE) / Type of subst. = KR003, KR004, #
BW_WBK_EHS_SVT_TR_001 TR Substances Notification (Core Workbook)	BW_QRY_MPR_EHS07_TR_00 01 TR Substances Notification (Core Query)	ZTR_CICR	CUB_EHS07, CREHS02	ICI, SO	Regulation Code (C_REGCODE) / Type of substance = TR001, #
BW_WBK_EHS_SVT_EU_001 EU REACH (Core Workbook)	BW_QRY_MPR_EHS07_EU_0 001 EU REACH (Core Query)	REACH	CREHS04, CREHS06	ICI, PRO, IMP	
BW_WBK_EHS_SVT_US_001 US TSCA CDR (Core Workbook)	BW_QRY_MPR_EHS07_US_0 001 US TSCA CDR (Core Query)	TSCA	CREHS05, CREHS07	IMP, ICI, PRO, EXP	
BW_WBK_EHS_SVT_US_002 US TSCA 12b (Core Workbook)	BW_QRY_MPR_EHS07_US_0 002 US TSCA 12b (Core Query)	ZUS_T12B	CREHS05, CREHS07	EXP	
BW_WBK_EHS_SVT_CA_001 Canada Non DSL Tracking (Core Workbook)	BW_QRY_MPR_EHS07_CA_0 001 Canada Non DSL Tracking (Core Query)	ZCA_DSL	CREHS05, CREHS07	IMP, PRO, ICI	Substance <> EXCLUDED
BW_WBK_EHS_SVT_CA_002 Extended tracking for Canada (Core Workbook)	BW_QRY_MPR_EHS07_CA_0 002 Extended tracking for Canada (Core Query)	ZCA_SVT	CREHS05, CREHS07	IMP, ICI, PRO	
BW_WBK_EHS_SVT_EU_003 SVT Report-Notification of nanomaterials Europe (core Work book)	BW_QRY_MPR_EHS07_EU_0 002 SVT Report-Notification of nanomaterials Europe (core Query)	ZEU_NANO	CREHS04 CREHS06	IMP, ICI, PRO	
BW_WBK_EHS_SVT_AU_001 AU Annual Reporting (Core Workbook)	BW_QRY_MPR_EHS07_AU_0 001 AU Annual reporting of chemicals - SO	ZAU_AICS	CREHS08	SO	

BW_QRY_MPR_EHS07_AU_0002 AU Annual reporting of chemicals - IMP+ICI	ZAU_AICS	CREHS08	ICI, IMP	
BW_QRY_MPR_EHS07_AU_0003 AU Annual reporting of chemicals - PRO	ZAU_AICS	CREHS08	PRO	
BW_QRY_MPR_EHS07_AU_0004 AU Annual reporting of chemicals - LOG	ZAU_AICS	CREHS08	ALL	Log_ID = Non initial

Main queries (Generic dataflow)

Query	Description
BW_QRY_CPEHSV01_0002	EHS - SVT Generic reporting Query (Core)
BW_QRY_CPEHSV01_0003	EHS - SVT Generic Reporting Synthesis Query (Core)
BW_QRY_CPEHSV01_0004	Query Control
BW_QRY_CPEHSV01_0005	Query Control Scenario
BW_QRY_CPEHSV01_0006	US TSCA 12b - Alerts (BCast)

Broadcast

The broadcast are run every Wednesday and Saturday, via the chain PC_EHS_014, which is included in weekly main chain PC_EHS_005(Saturday) and PC_EHS_NA_001 (Wednesday)

For Broadcast diffusion, it has been decided to split broadcast by company code using Bursting option for Broadcast

Link to bursting documentation <https://docs.google.com/document/d/15DaFZFECYsfZc98zzlox-J3QaCYbbGsMTd7GxbSHOMM/edit#heading=h.fct6jj0qa4s>

Availables broadcast

ONLY the US BroadCast is available.

Other broadcasts will be implemented later by BW maintenance team, via freshdesk process.

US Broadcast rules

Aim : hold alert for the first expedition, for a tracked substance, a company code, a destination country within the same year.

Alert limited to :

- regulatory list US_T12B
- scenario EXP
- country of origin US + PR, GU, VI, AS , MP
- country of destination (ship to) different from US = US + PR, GU, VI, AS , MP

Additional rule :


The delivery creation date has to be the same year as goods issue date.

Broadcast solution

The bex query BW_QRY_MPR_EHS07_001 / US TSCA 12b - Alerts (BCast) identify possible alets.

A filter is handle in the DTP to limit the concerned countries for US :

- country of origin US + PR, GU, VI, AS , MP
- country of destination <> US + PR, GU, VI, AS , MP (means the country of the ship-to)

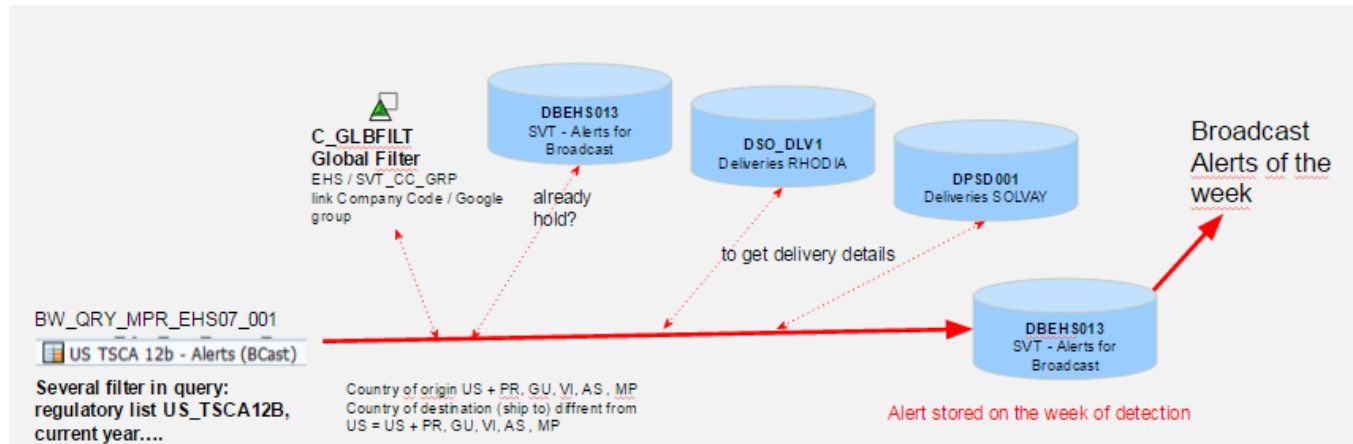

The transformation determines :

- if the alert has already been sent by looking in the DSO DBEHS013 / SVT - Alerts for Broadcast
- the delivery information by looking in Deliveries DSOs (DSO_DLV1 for Rhodia, DPSD001 for Solvay) as we do not have deliverie details in the SVT cubes
- the google group to which the alert has to be send (C_GLBFLT)

Important :

The DSO DBEHS013 contains the already sent alert.

Do not empty it, history can not be reloaded without any flow modifications and alerts will be sent again.

The link company code / google group is stored in MD Global Filter (C_GLBFLT) => see current procedure

The google group email adress are stored in MD Google Group (C_GROUP) => see current procedure

Google groups have been listed by business and are available via following link <https://drive.google.com/file/d/1iVBgzuaEH5Ogy4ripqEIAN8hP27VZIO65FvLvWhxOfM/view>

The creation of the 11 google groups have been asked to France Infra-servicedesk the 21st of december 2015.

=> but only the first one ' SSP WW' for US is read

Queries used for broadcast

Cou ntry	Broadcast	Query	Query Description	Query Type	Variante prog RSRD_BROADCAST_STARTER
US	BW_QRY_EHS_SVT_US_0001	BW_QRY_DBEHS013_0001	BCAST EHS SVT - US Alerts - Regulatory list ZUS_T12B	Alert	EHS_SVT_US_001 Send EHS SVT Alerts for US
		BW_QRY_DBEHS013_0002	BCAST EHS SVT - US Alerts - Regulatory list ZUS_T12B (Burst)	Destination list (for Bursting option)	

Detail of US Broadcast email

Broadcast with busting option using query BW_QRY_DBEHS013_0002 created for busting purpose and attribut "E-Mail Address" of master data Google Group (C_GROUP)

The alert of the week will be split by google group (C_Group) and sent to the google group address or person address found in C_Group

Settings for Object Type Query Open | Overview of Scheduled Settings

Description	Technical Name	Owner	Last Changed	Scheduled
EHS SVT US Alert (ZUS_T12B)	BW_QRY_EHS_SVT_US_0001	BW_BCAST	07.01.2016 09:15:18	No

Create New Setting Create New Setting with the Wizard

Setting EHS SVT US Alert (ZUS_T12B)

Description EHS SVT US Alert (ZUS_ Technical Name BW_QRY_EHS_SVT_US_0001

Distribution Type Broadcast E-Mail (Bursting) Output Format XML (MS Excel) ☐ As ZIP File

Recipient Determination User/Language Texts General Precalculation Filter Navigation

Characteristic for Recipient Determination

☐ Send Document Unchanged Characteristic

☒ Filter Document by Characteristic Value Characteristic Google Group

Attribute for Recipient Determination E-Mail Address Attribute Value Is E-Mail Address

Selection of the Characteristic Values

☐ By Following Selection
Selection Create

☒ By Control Query
Control Query BW_QRY_DBEHS013_0002 Variant (No Selection Possible)

Save Save as... Check Schedule Execute Close

Content of the email

Broadcaster

Settings for Object Type Query Open | Overview of Scheduled Settings

Description	Technical Name	Owner	Last Changed	Scheduled
EHS SVT US Alert (ZUS_T12B)	BW_QRY_EHS_SVT_US_0001	BW_BCAST	07.01.2016 09:15:18	No

Create New Setting Create New Setting with the Wizard

Setting EHS SVT US Alert (ZUS_T12B)

Description EHS SVT US Alert (ZUS_ Technical Name BW_QRY_EHS_SVT_US_0001

Distribution Type Broadcast E-Mail (Bursting) Output Format XML (MS Excel) ☐ As ZIP File

Recipient Determination User/Language **Texts** General Precalculation Filter Navigation

Subject BW - EHS SVT - TSCA 12B Alerts (Broadcast) Importance Medium

Contents

Hello,

This is an automatic e-mail.
Please find attached the TSCA 12B alert report for this week.
It tracks the first export of the year for a material containing a substance listed on TSCA 12B above its de minimis value, for a combination ship to country/company code.

Regards,
BW CC Team

Save Save as... Check Schedule Execute Close

Other info for futur broadcast

For other broadcast, another rule will be used to define a threshold for each regulatory list.

Stream EHS / Rule SVT_LIMIT : One threshold by regulatory list

To harmonize threshold, all should be set to 80% except Turkey which is 100%

No threshold for reg list ZUS_T12B (threshold = 1st expedition)

Broadcast tonnage band alert (ABEHSV07, CPEHSV08)

Dependencies with other applications


EHS SVT is adding EHS information on transactional data : Purchasing (Application SPRINT), Production, Sales (OBAS)

Data Loading

Info Providers and objects loaded

Other Chains

Process Chain	Code	Type	Frequency	Comments
EHS - Master Chain Hist Load	PC_EHS_MAIN_HIST_LOAD	ONE SHOT		This chain can be used to reload data without using global filters values, and without reload referentials Dsos Global filters C_GLBFLT : stream EHS / rule DATA*
EHS - TD - SVT - TSCA dataflow - Metachain	PC_EHS_SVT_DAILY_TSCA	MAIN	Daily at 10H.	Contain subchain PC PC_EHS_SVT_OLD_FLW_TSCA and then PC_EHS_014. Decision tree to execute or not : Executed on monday, tuesday, thursday or friday.

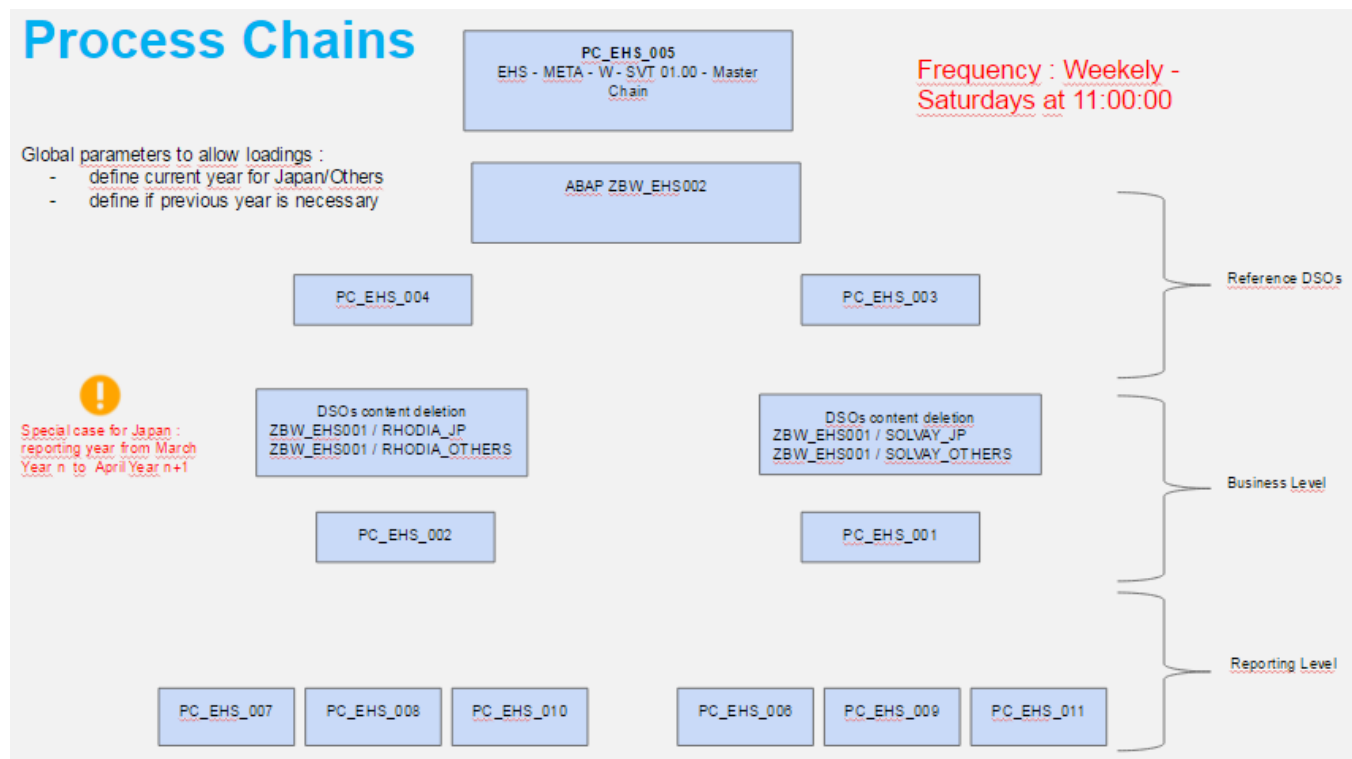

Process Chains : for reloading


These 2 Process chains are usefull if you need to reload EHS :

- for a dedicated period (C_GLBFLT)
- without reloading Reference DSOs



Characteristic C_GLBFLT - maintain master data: List

Stress	Rule	Counter	Global Filter Descr	Sign	Option	Low	Hight	Active
EHS	DATA_JP	1	JAPAN - Current Exercice	1	EQ	201404	201503	Y
EHS	DATA_JP	2	JAPAN - Previous Exercice	1	EQ	201403	201403	Y
EHS	DATA_OTHER	1	OTHER - Current Exercice	1	EQ	201401	201412	Y
EHS	DATA_OTHER	2	OTHER - Previous Exercice	1	EQ	201312	201312	Y

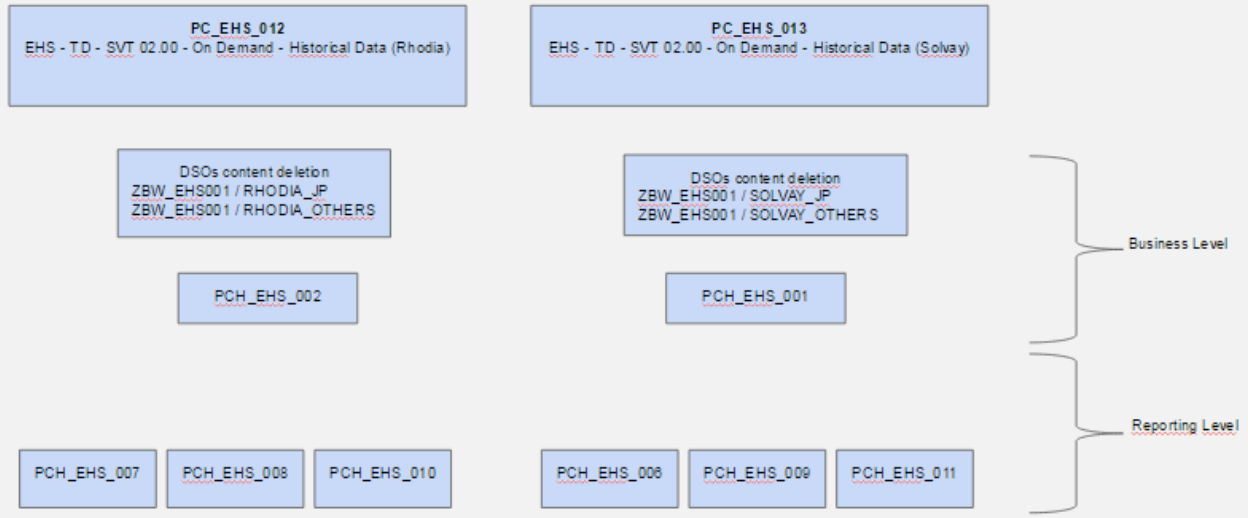

Data Quality Control

Operational Documentation

Procedures

<Describe the recurring procedures needed to operate the application (eg. start/pause/terminate/restart the app processes, data preparation, data ingestion, ETL, data visualization, data export, other manual activities)>

Scheduling

<Describe the scheduling in place for the application (eg. existing jobs, trigger time/event based, dependencies)>

Monitoring

<Describe the monitoring checks to confirm the application is performing well (eg. check the overall status, check performance metrics like runtime /data volume/memory/disk/CPU, maintain and react to alerts/notifications)>

Error Handling

<Describe how to handle errors (eg. error codes, description and respective resolution, alert users)>

Known Bugs

<List the existing bugs, its criticity, workarounds and resolution plan.>

Roadmap

<List past & future evolutions for the application (including links to MED/FSD/TSD)>